

Figure 15.3

Key

- 7

Network Constraint
- 4

Sensitive Location
- Constraints & Sensitive Locations
- 1

Upgrade junction from Sella Ness Port
- 2

Junction and culvert South of Mossbank
- 3

VOE Settlements
- 4

Upgrade junction of A968/A970
- 5

Upgrade junction of A970/B9075
- 6


Upgrade B9075
- 7

B9075 South of Kergord - Environmentally Sensitive
- 8

Structure to be assessed
- 9

Structure to be assessed
- 10

Settlements on A971

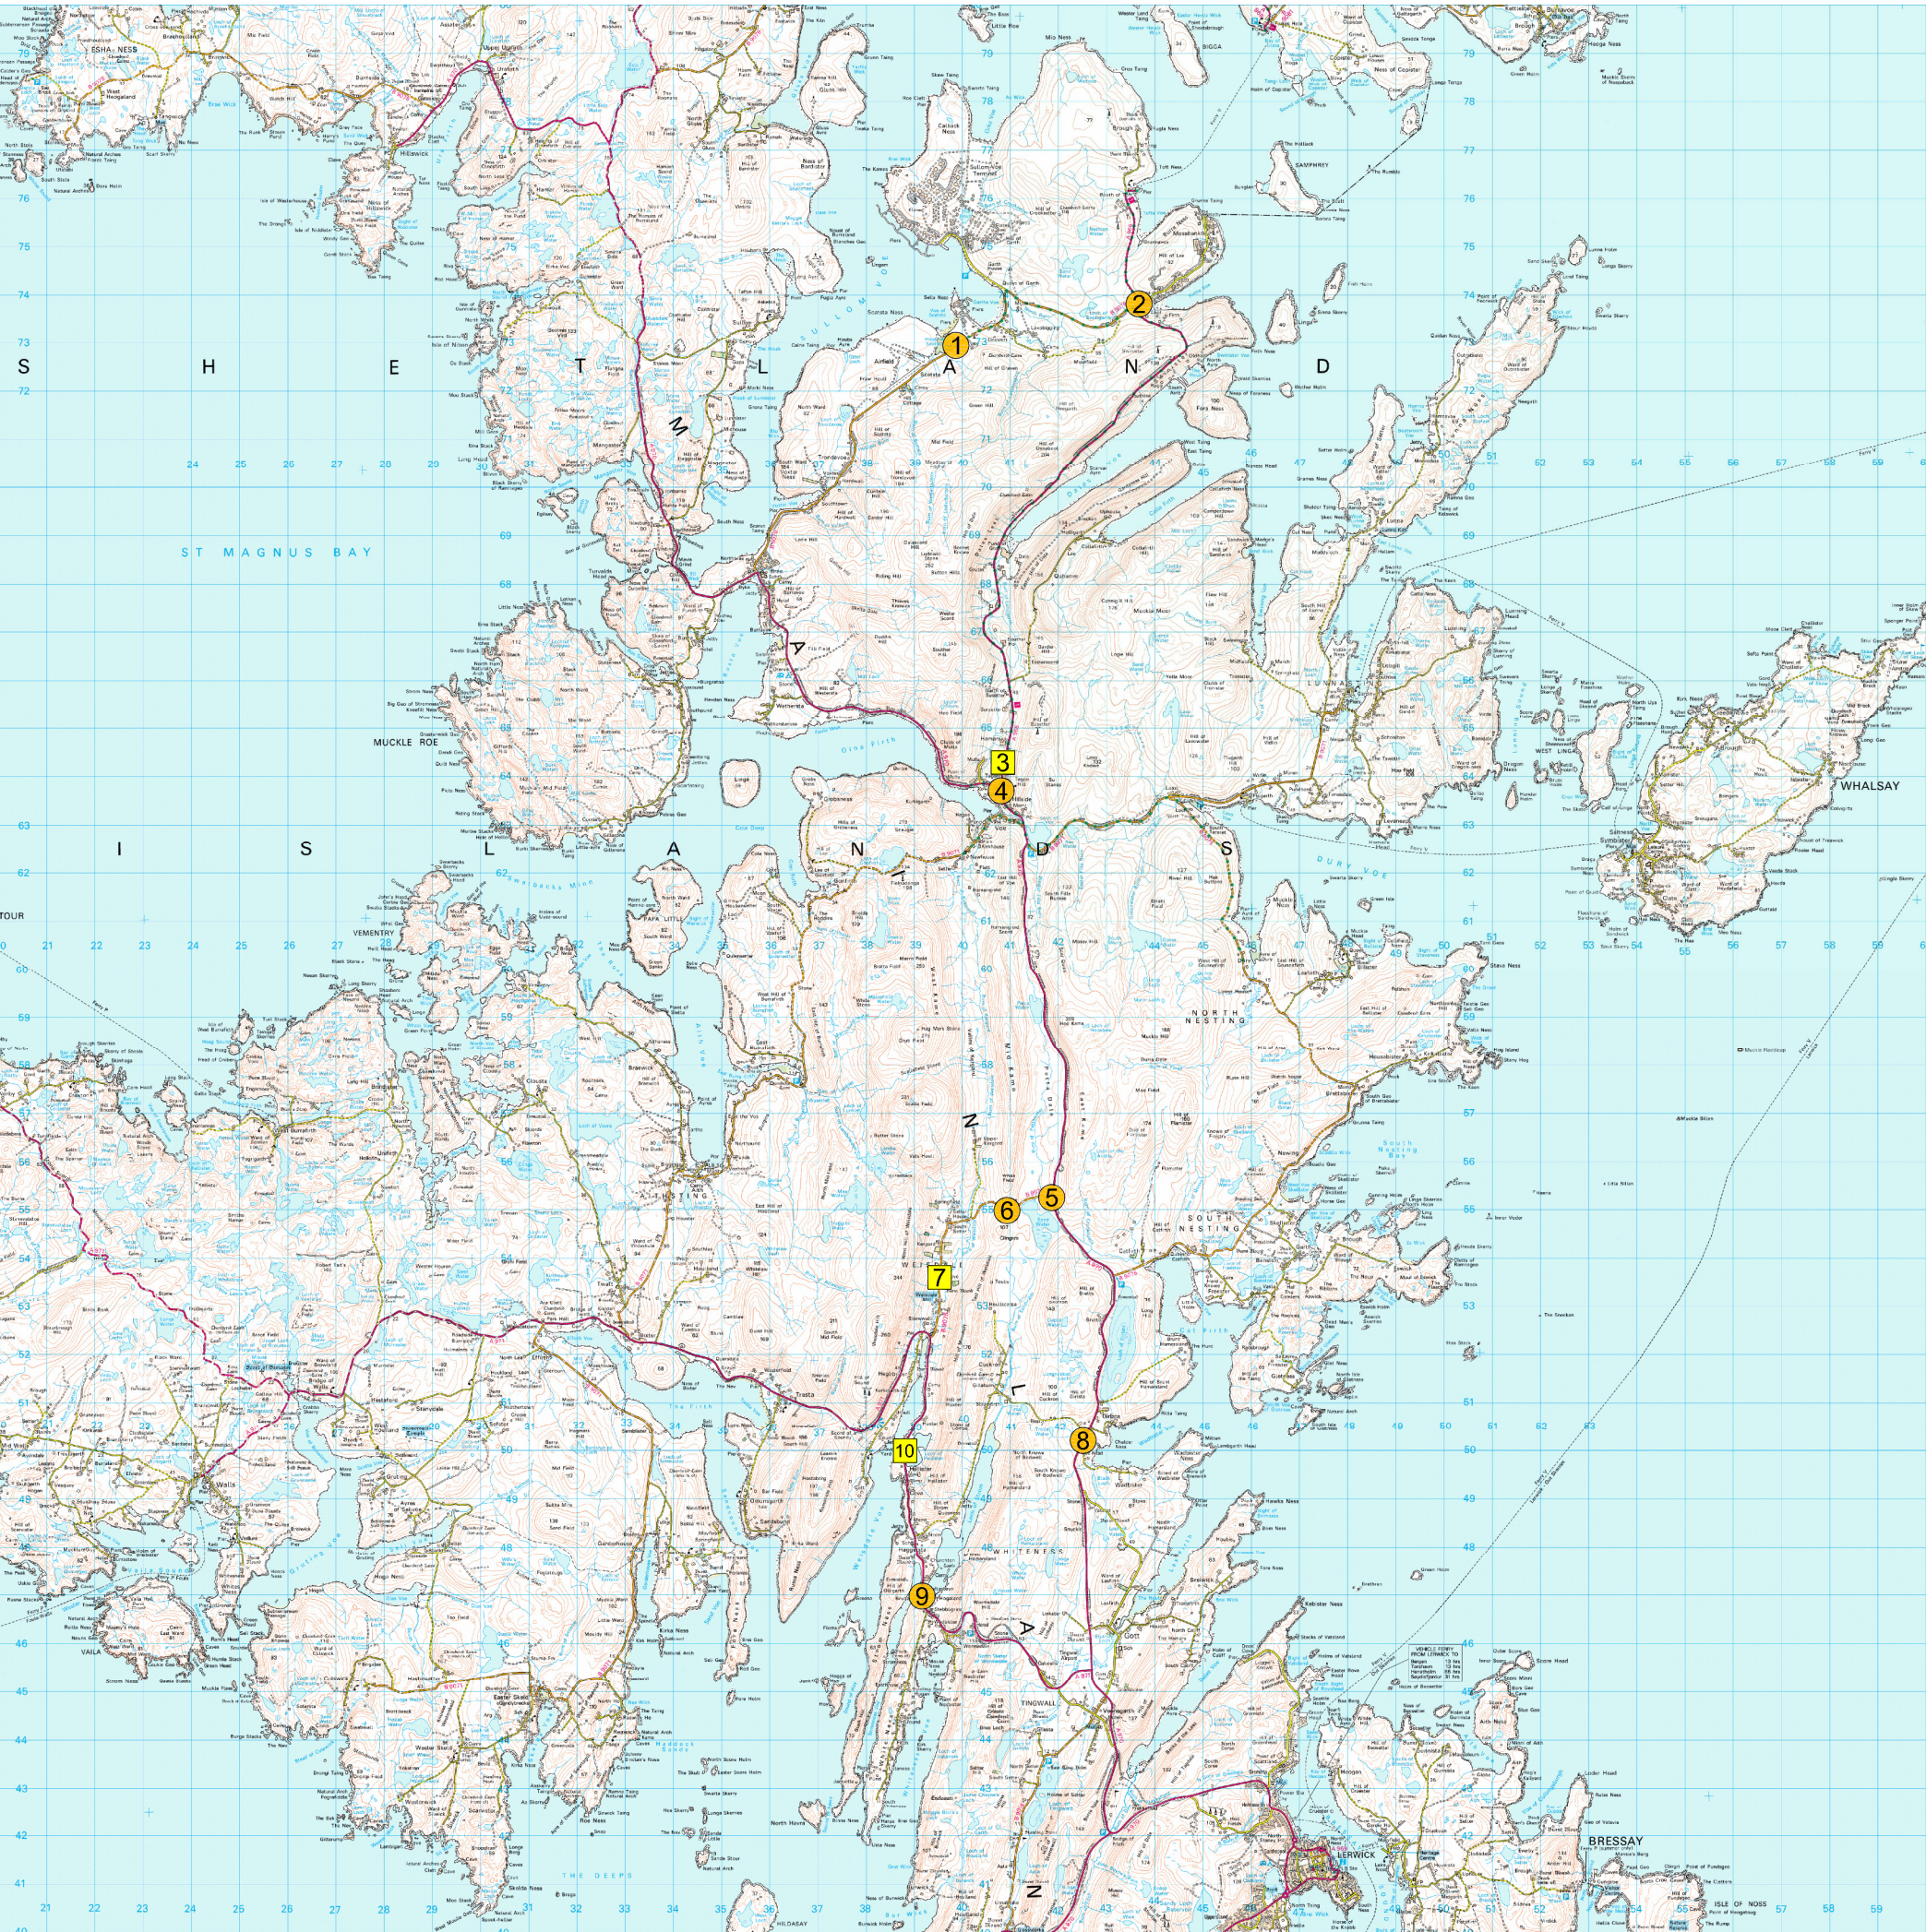

Client:	<div> viking energy Harnessing Shetland's natural resources</div>		
Project:	Viking Wind Farm		
Title:	NETWORK CONSTRAINTS AND SENSITIVE LOCATIONS		
Scale:	NTS	Date:	Dec 2008