

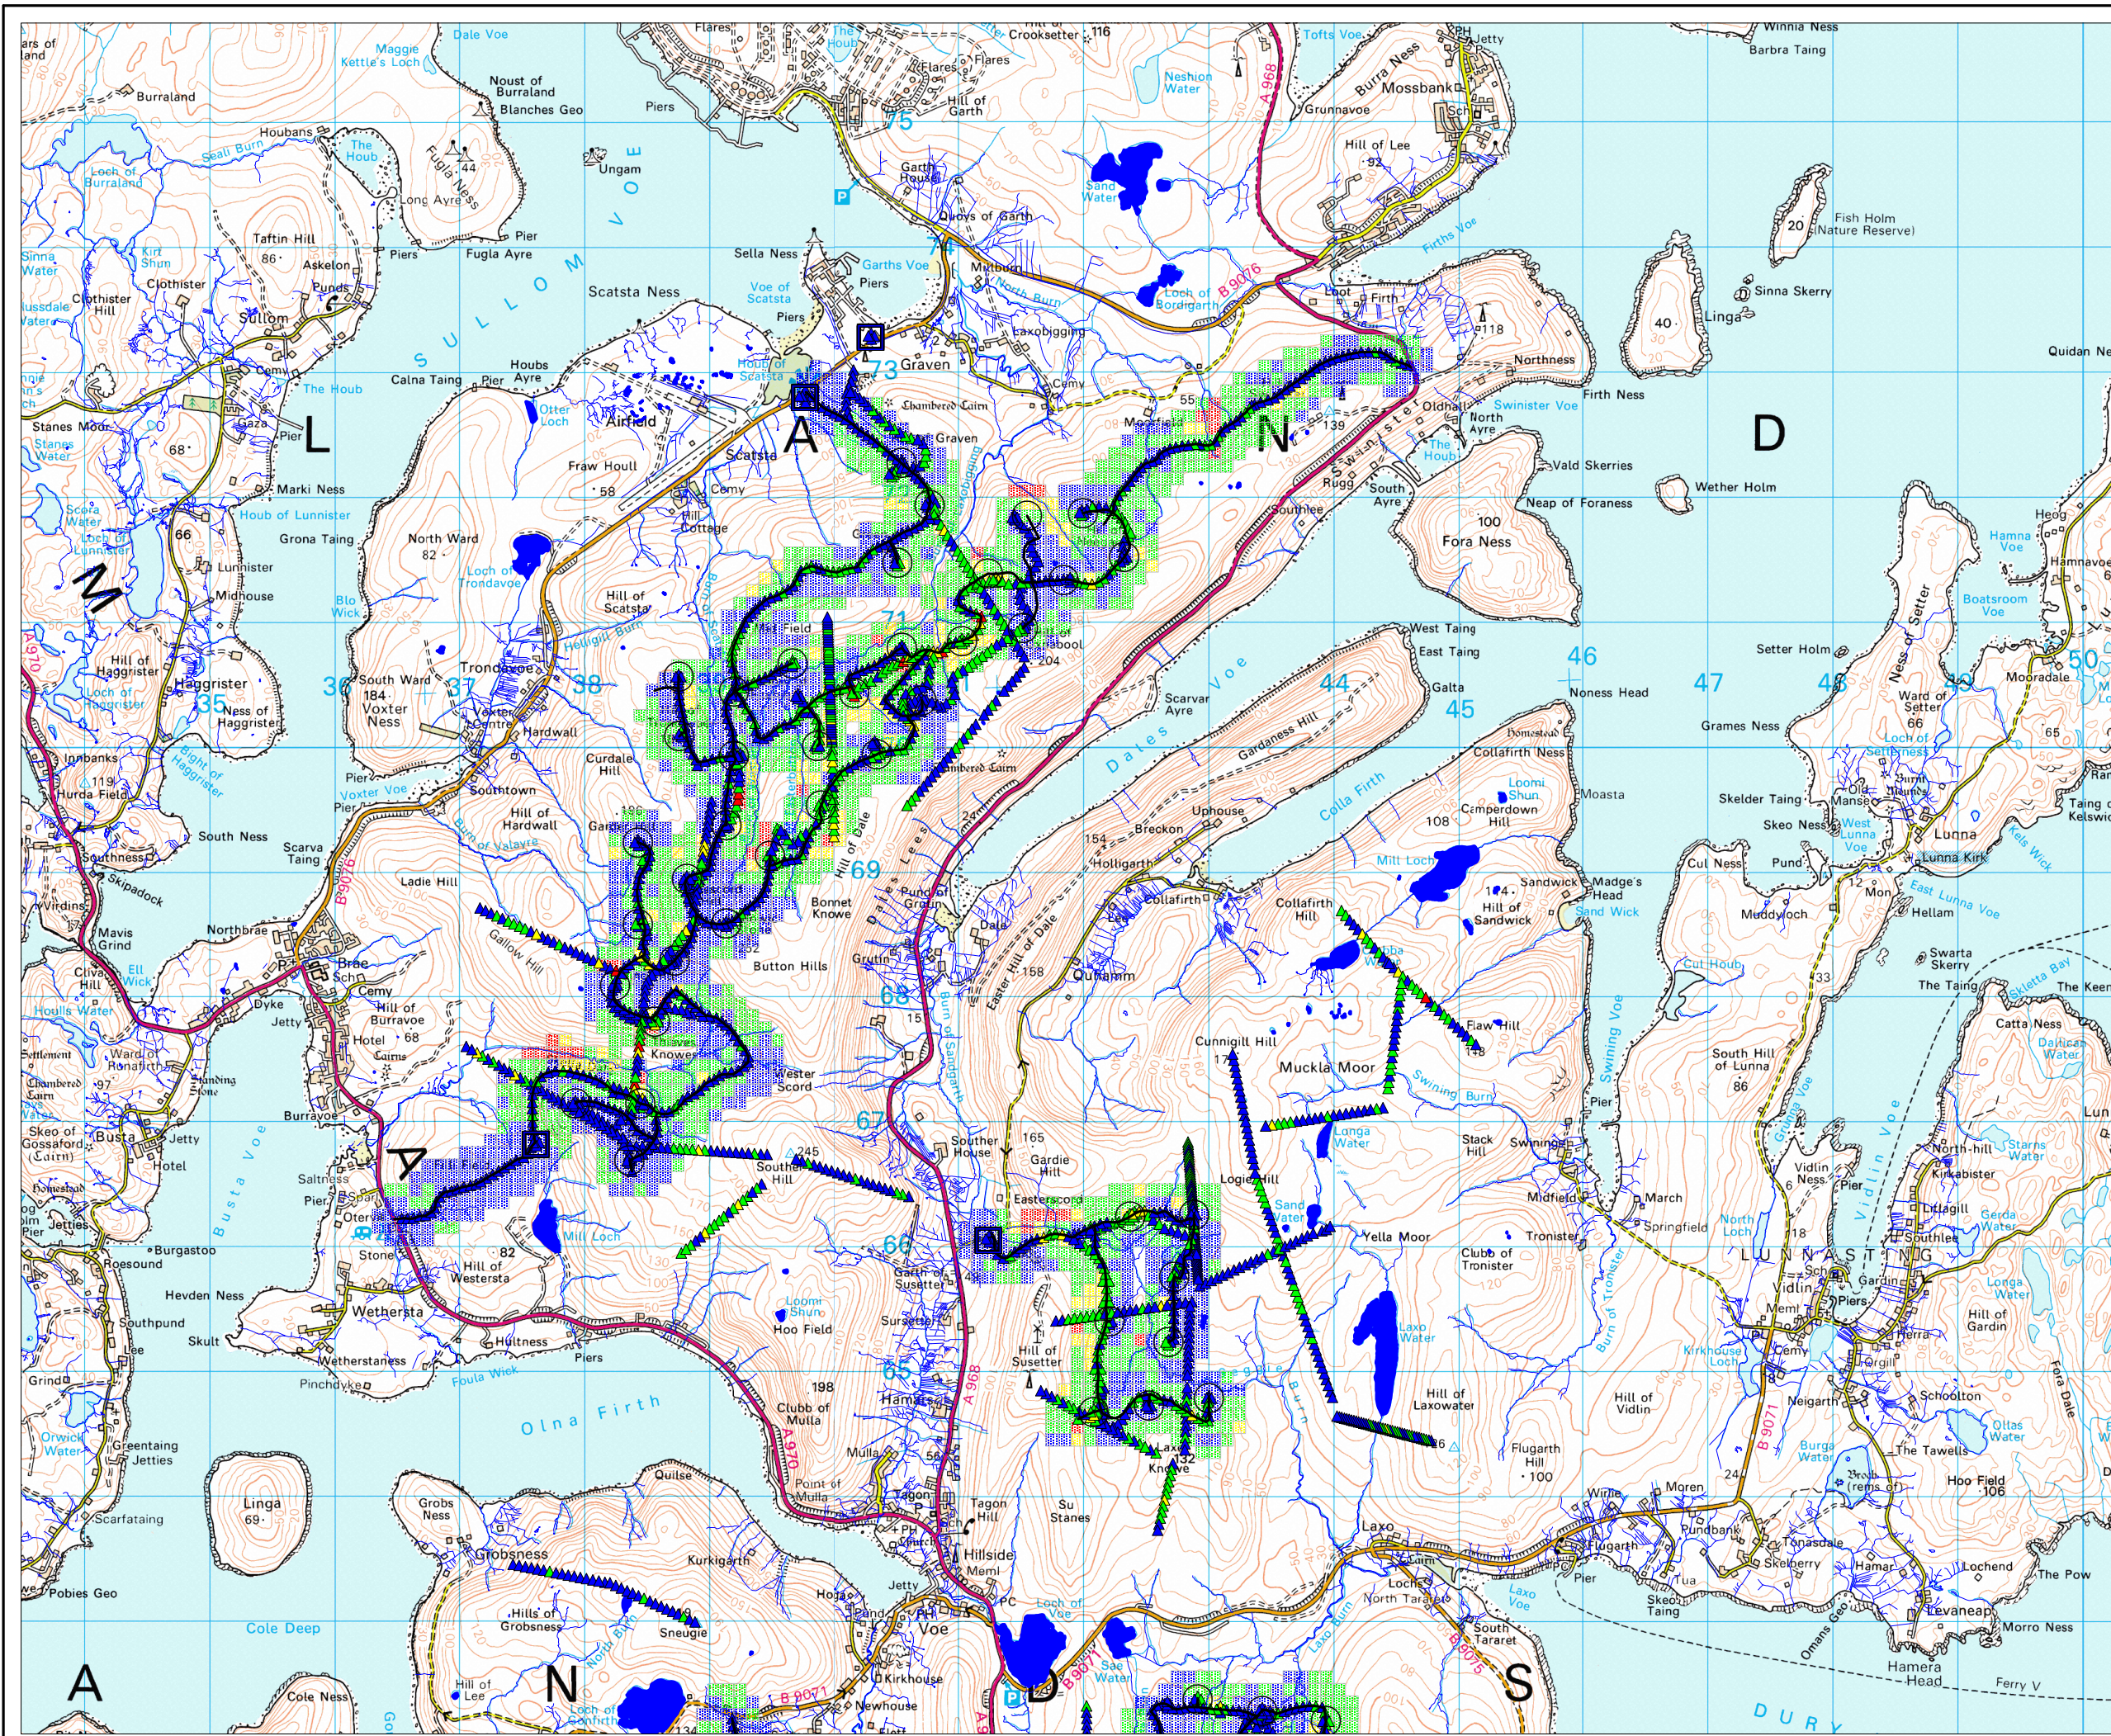


Figure 14.1.PS09(a)

Key

- Proposed turbine location
- Access track (simplified)
- Provisional construction compound location
- Proposed converter station location
- Watercourses
- Waterbodies

Factor of safety at probing point

- ▲ <1 (57)
- ▲ 1-1.3 (158)
- ▲ 1.3-2.5 (1610)
- ▲ >2.5 (3920)

Factor of safety grid

- <1 (212)
- 1-1.3 (480)
- 1.3-2.5 (2544)
- >2.5 (1996)

Using 100m x 100m grid cells

Client	 viking energy Harnessing Shetland's natural resources		
Project	Viking Wind Farm		
Title	Factor of Safety - Delting & Collafirth		
Scale	1:50,000 @ A3	Date	16/01/09

