

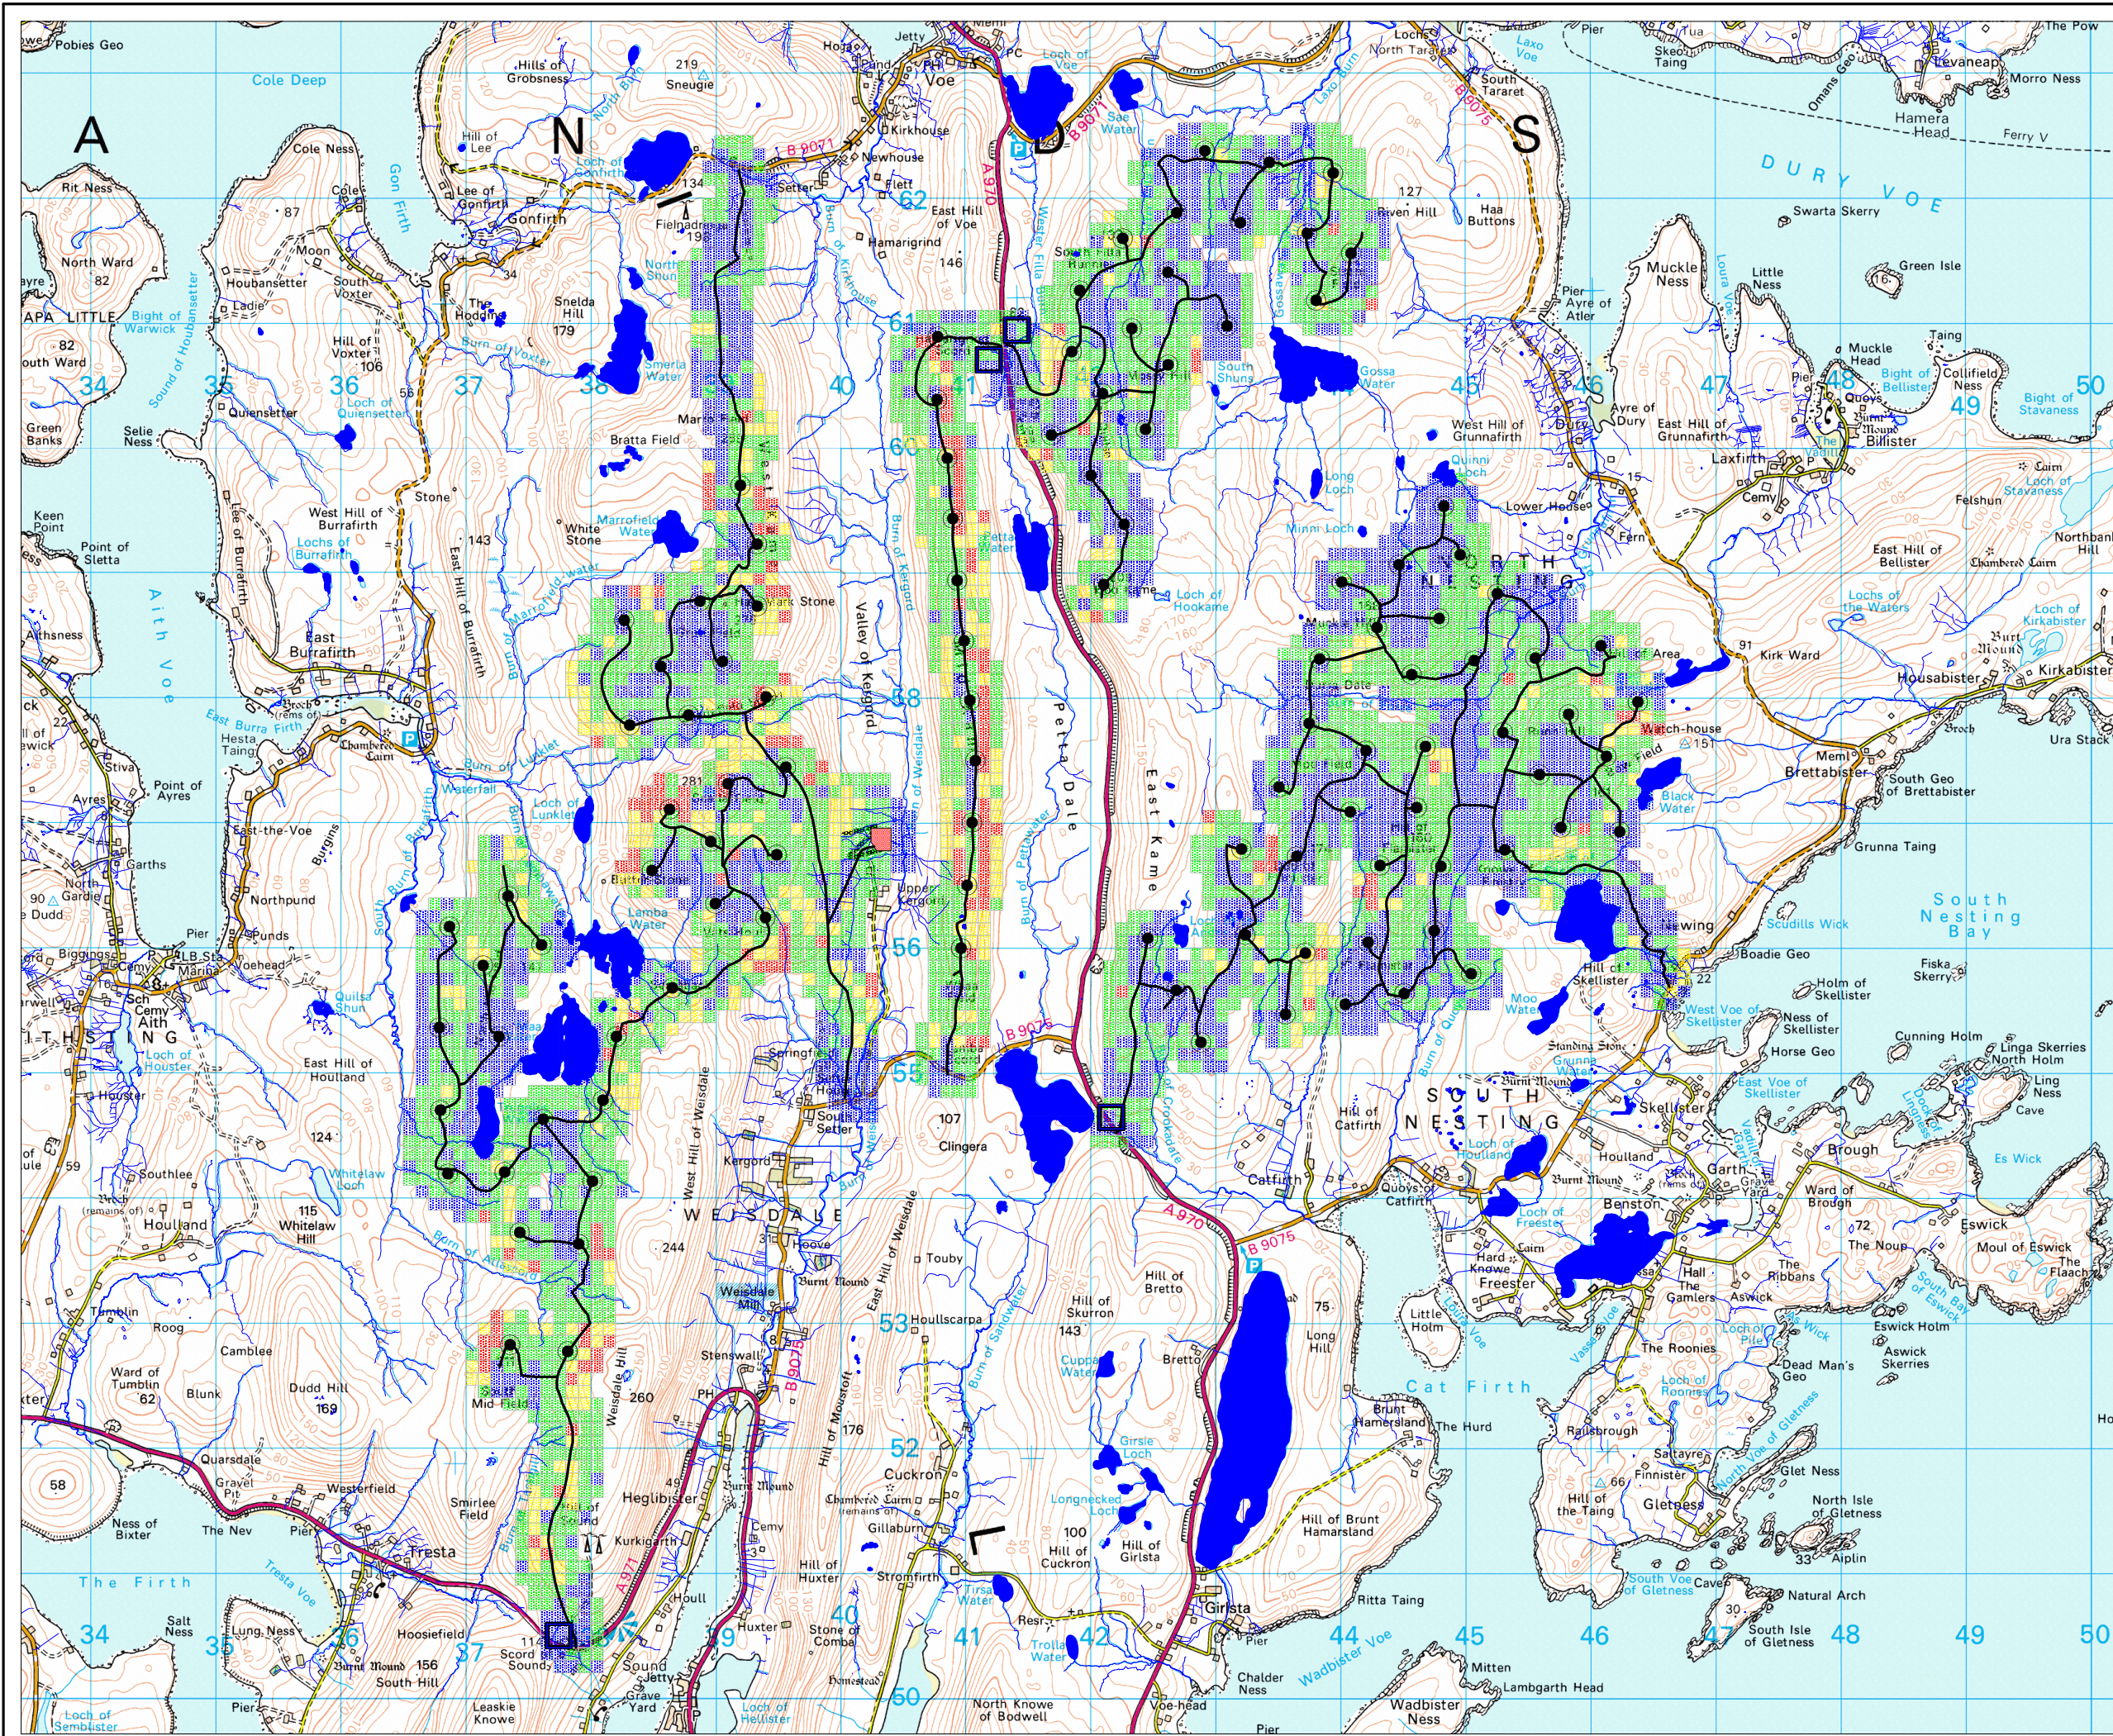



Figure 14.1.PS10(b)

Key

- Proposed turbine location
- Access track (simplified)
- Provisional construction compound location
- Proposed converter station location
- Watercourses
- Waterbodies

Hazard Zonation

- Probable (207)
 - Likely (485)
 - Unlikely (2645)
 - Negligible (1895)
- Using 100m x 100m grid cells



Client	 viking energy Harnessing Shetland's natural resources		
Project	Viking Wind Farm		
Title	Hazard Zonation - Kergord & Nesting		
Scale	1:50,000 @ A3	Date	16/01/09

