

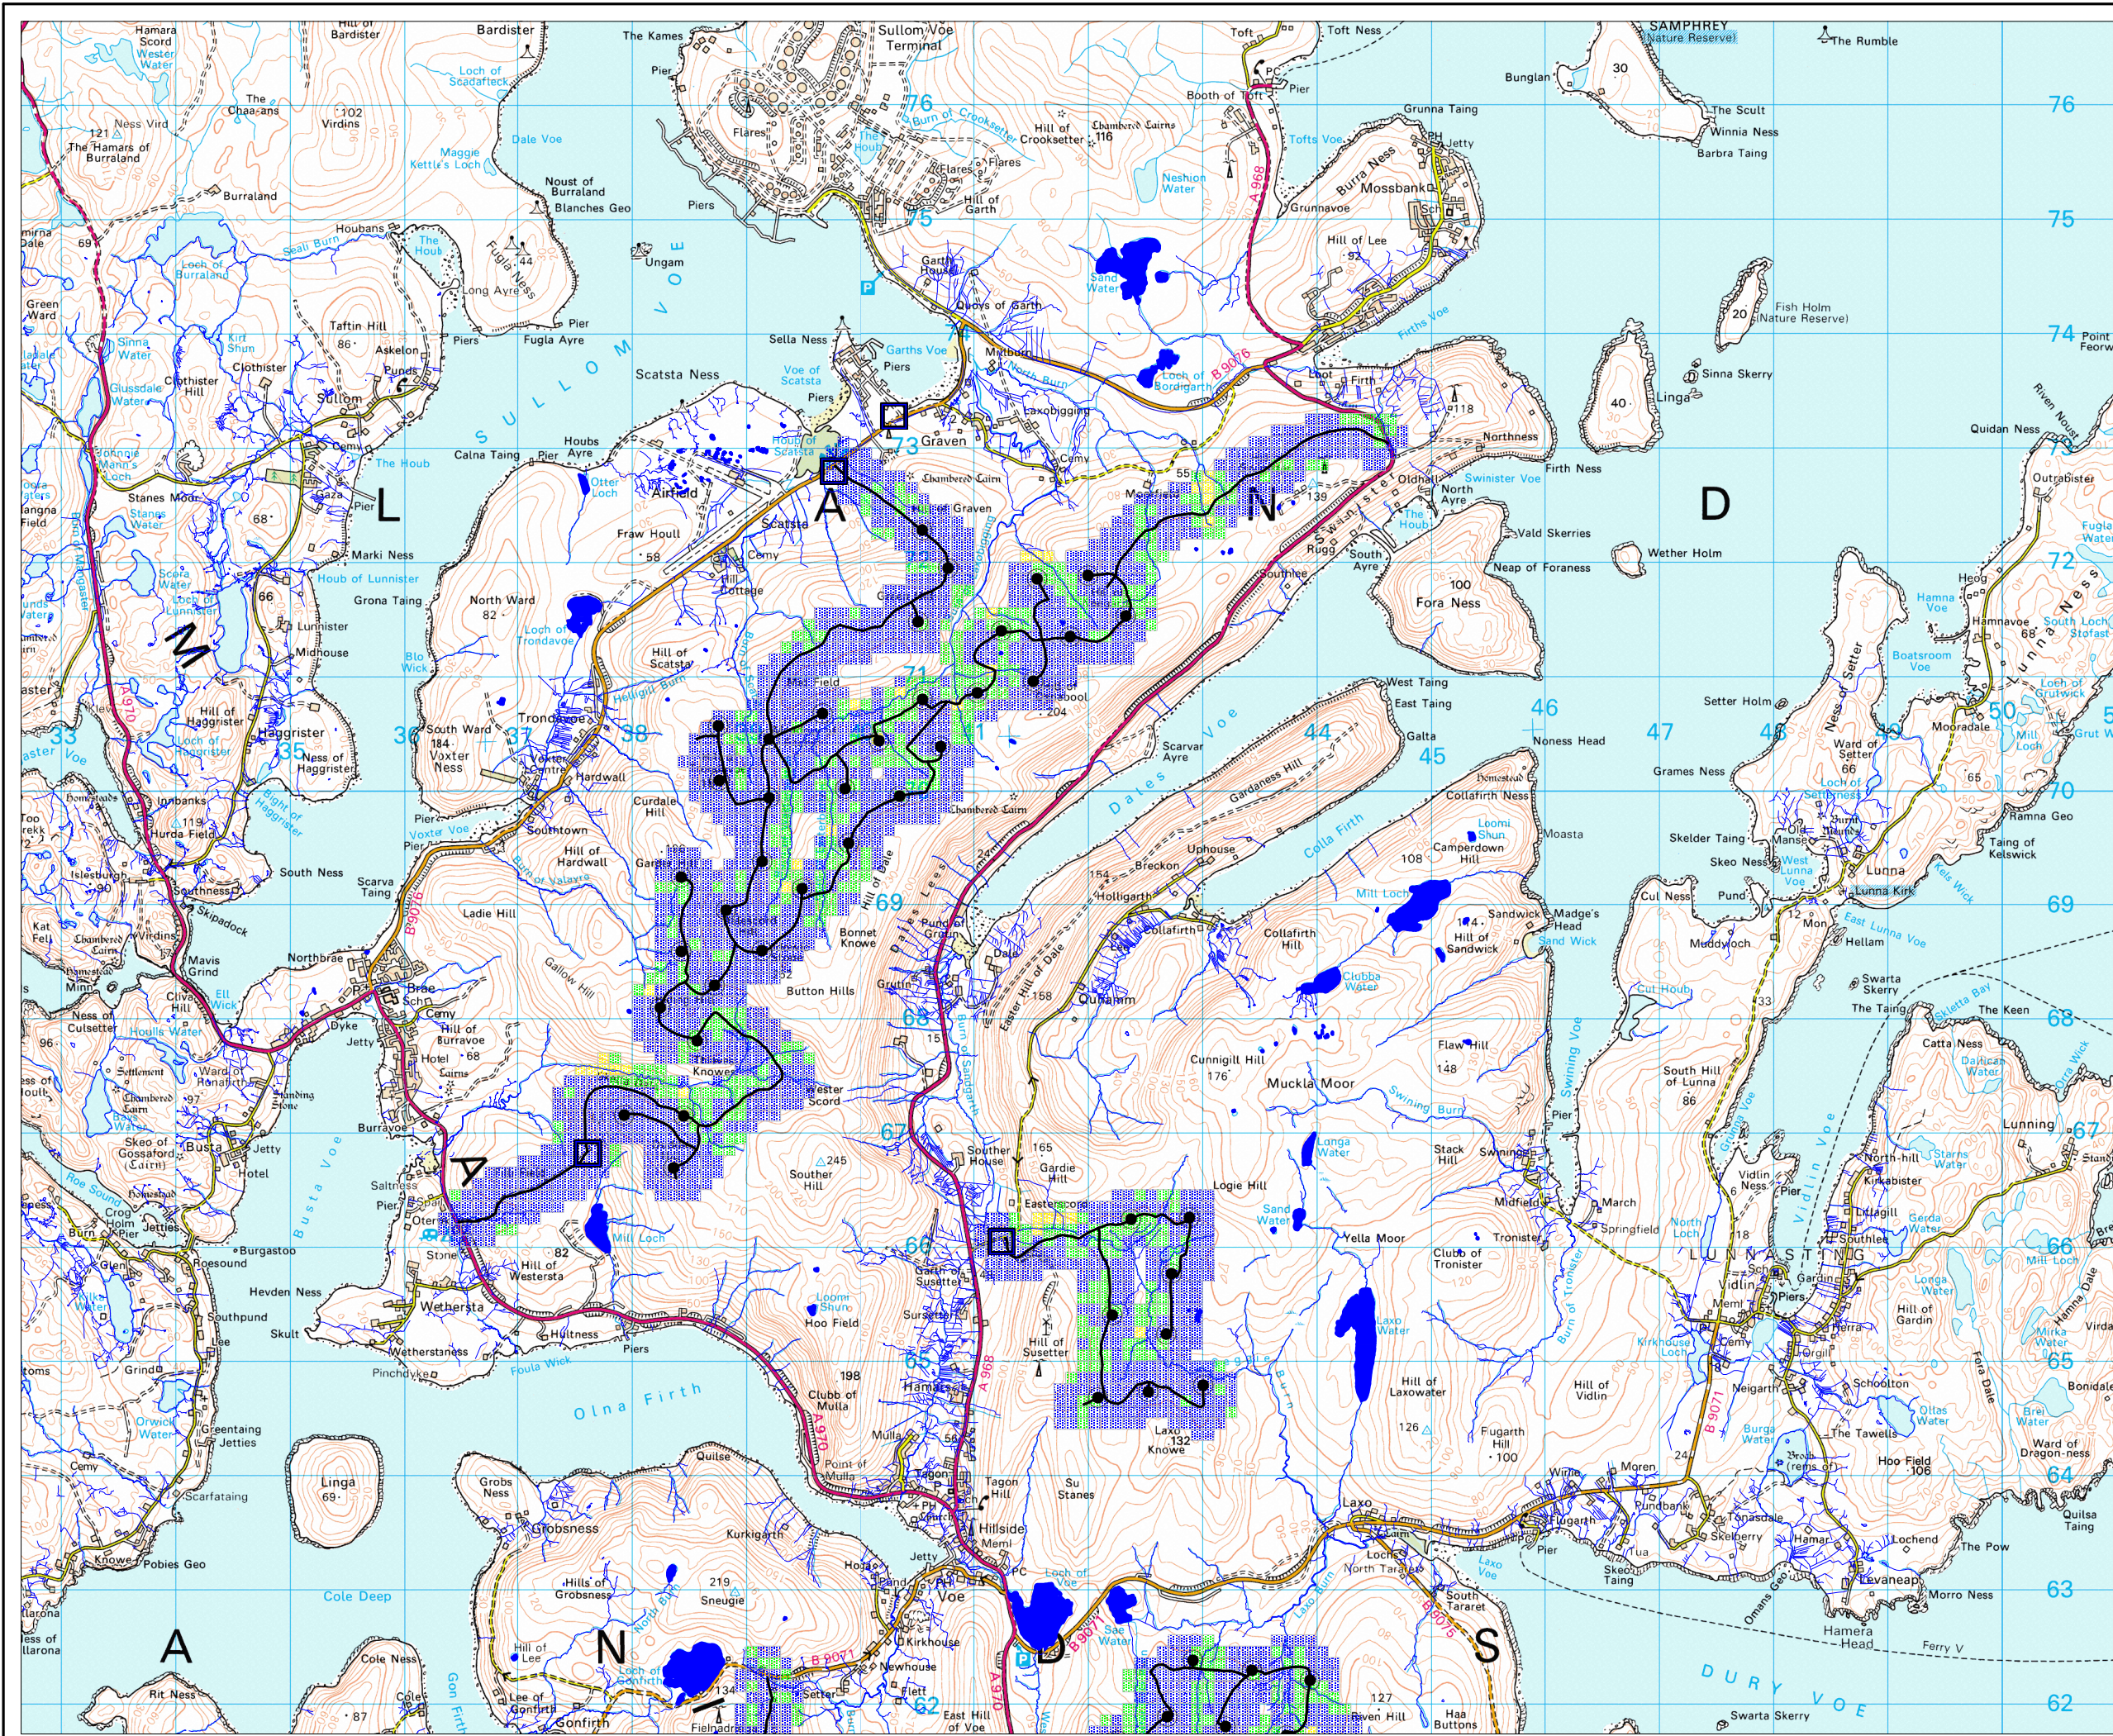


Figure 14.1.PS12(a)

Key

- Proposed turbine layout
- Access tracks (simplified)
- Proposed converter station location
- Provisional construction compound location
- Watercourses
- Waterbodies

Hazard Ranking

- Substantial (60)
- Significant (1392)
- Insignificant (3780)

Using 100m x 100m grid cells

Client	 viking energy Harnessing Shetland's natural resources		
Project	Viking Wind Farm		
Title	Hazard Ranking - Delting & Collafirth		
Scale	1:50,000 @ A3	Date	16/01/09

